

CITY OF BERRY HILL, TENNESSEE

SUPPLEMENTAL

BEST MANAGEMENT PRACTICES

(BMP)

MANUAL

Prepared by:

Civil & Environmental Consultants, Inc.



624 Grassmere Park Drive, Suite 21 • Nashville, Tennessee 37211-3671

Phone 615/333-7797 • Fax 615/333-7751 • Toll Free 800/763-2326 • E-mail nashville@cecinc.com

TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
Introduction and Purpose.....	1
Land Disturbance Permit Checklist.....	2
Supplemental BMPs.....	3
 <u>Appendices</u>	
Appendix A	Comprehensive Stormwater Ordinance
Appendix B	NPDES General Permit for Discharges from Small MS4s
Appendix C	Land Disturbance Permit Information Handout

BMP Manual Supplement

City of Berry Hill, Tennessee

Introduction & Purpose

This Best Management Practice (BMP) Manual supplement is provided to meet the following objectives:

- provide an introduction to the two BMP Manuals produced by the Tennessee Department of Environment and Conservation and the Tennessee Water Resources Research Center and adopted by the City;
- provide specific information regarding the City's Construction Stormwater Runoff Control Program through a Land Disturbance Permit Application checklist;
- provide additional BMPs that have specific application to smaller lot development which is the most anticipated type of development within the City.

The goal of the stormwater ordinance, the two BMP Manuals, and this Supplemental BMP Manual is to improve the quality of stormwater runoff in the City by regulating construction and long-term maintenance activities and providing the tools necessary for meeting the regulations.

The first BMP Manual, *the Tennessee Erosion and Sediment Control Handbook, 2nd Edition* available at http://www.state.tn.us/environment/wpc/sed_ero_controlhandbook/, provides detailed procedures for controlling erosion and preventing sediment runoff from construction sites. These structural and non-structural procedures can be adapted to individual construction sites for compliance with the Tennessee Construction General Permit (TCGP). Prior to March 10, 2003, construction sites disturbing five (5) or more acres were required to comply with the TCGP; however, since March 10, 2003, the area requirement has been lowered to one (1) acre. Individual Municipal Separate Storm Sewer Systems (MS4s) like the City of Berry Hill had the option of lowering this requirement to less than one (1) acre. The stormwater ordinance included as an attachment to this supplement details the specific requirements of the City of Berry Hill regarding what size area of disturbance among other site conditions may require a land disturbance permit from the City.

The second BMP Manual, *the Guide to Selection and Design of Stormwater Best Management Practices, March 2003* available at <http://eerc.ra.utk.edu/divisions/wrrc/BMP/bmp.htm>, is a guide for post-construction practices. Phase II of the National Pollution Discharge and Elimination System (NPDES) requires an emphasis be placed upon the long-term maintenance of post-construction BMPs. This manual provides detailed information about various structural and non-structural practices to enhance water quality and mitigate excessive water quantity from developed sites.

The City of Berry Hill adopted a stormwater ordinance on September 13, 2004 to comply with Phase II of the NPDES program as administered by the Tennessee Division of Water Pollution Control. The ordinance provides for a Construction/Post-Construction Runoff Control Program development requiring specific erosion and sediment control practices for disturbed areas greater than one (1) acre or as otherwise specified in Section 3 of the stormwater ordinance. Following is a summary of the requirements for obtaining a land disturbance permit for regulated land disturbing activities within the City of Berry Hill. A completed copy of this checklist shall accompany each land disturbance permit application.

City of Berry Hill, Tennessee Land Disturbance Permit Checklist

Item	Description	Provided (Y or N)
1	Provide a copy of the Notice of Intent (NOI) submitted to the Tennessee Division of Water Pollution Control (TDWPC) if one was required according to the Tennessee Construction General Permit.	
2	If an NOI was required, provide a copy of the Stormwater Pollution Prevention Plan (SWPPP).	
3	Provide all information including maps, calculations, narrative descriptions, etc. required by <i>Section 3 Land disturbance permits (4) Application for a land disturbance permit</i> of the City of Berry Hill's Stormwater Ordinance. The requirements of <i>Section 3(4)</i> overlap with those for a SWPPP; therefore, submittal of the SWPPP with attachments to demonstrate compliance with any additional requirements of the stormwater ordinance is acceptable.	
4	Grading permit review fee of \$250.00.	
5	Provide a copy of any other environmental permit such as an Aquatic Resource Alteration Permit (ARAP) that is required by other authorities for the disturbance of the site.	

Supplemental Best Management Practices (SBMPs)

Small-lot development is expected to be the primary form of land-disturbing activity within the City of Berry Hill. There are applicable BMPs in both BMP Manuals for this type of development; however, there are additional BMPs specifically designed for small-lot developments that are listed below:

SBMP #	Description	Comments
SBMP-1	Curb and Gutter Sediment Barrier	Drawing and commentary provided below.
SBMP-2	Curb Inlet Sediment Barrier	Drawing and commentary provided below.
SBMP-3	Silt Fence	Drawing and commentary provided below.
SBMP-4	Straw Rolls	Drawing and commentary provided below.
SBMP-5	Temporary Silt Fence with Backing	Drawing and commentary provided below.
SBMP-6	Enhanced Silt Fence	Drawing and commentary provided below.
SBMP-7	Temporary Erosion Ditch Check Using Enhanced Silt Fence	Drawing and commentary provided below.
SBMP-8	Erosion Control Fabric Joining Details	Drawing and commentary provided below.
SBMP-9	Disconnected Roof Drains	Commentary provided below.

SBMP-1 & 2

Curb and Gutter Sediment Barrier & Curb Inlet Sediment Barrier

These BMPs will require special consideration in their application due to the potential for ponding water within a roadway should they not be consistently maintained. If at all possible, discharge of filtered construction runoff should be directed to open swales, not directly to the storm sewer system via a catch basin; however, sometimes this may not be possible.

SBMP-3

Silt Fence

Silt fence is probably the most extensively used BMP for controlling construction runoff. This detail provides an acceptable alternative to the typical trenching method of anchoring the fabric. Installation of silt fence without anchoring the fabric is useless as an erosion and sedimentation control structure.

SBMP-4

Straw Rolls

Straw rolls or wattles are an alternative to typical silt fence in most situations. They have particular advantages for stabilizing small disturbed areas including ease of installation and ability to remain in place since they degrade over time.

**SBMP-5
Temporary Silt Fence with Backing**

This BMP is applicable in situations where the normal non-reinforced silt fence is not structurally capable of withstanding the forces placed upon it, typically in situations where the fence is installed along the toe of a fill slope greater than 15 feet in height. It may also have application along a floodplain or wetland boundary or other environmentally sensitive area in which a sediment release would have greater consequences.

**SBMP-6 & SBMP-7
Enhanced Silt Fence & Temporary Erosion Ditch Check Using Enhanced Silt Fence**

SBMP-6 is the only silt fence type BMP applicable for concentrated flow. SBMP-7 provides detail for its most common application as a substitute for rock check dams. It has the advantages of being easier to install and remove than stone check dams.


**SBMP-8
Erosion Control Fabric Joining Details**

The secure joining of silt fence fabrics is of paramount importance. Following this BMP will help to ensure a successful installation by eliminating an inherent weak spot in the silt fence.

**SBMP-9
Disconnected Roof Drains**

The 2nd BMP Manual provides a detail of a disconnected roof drain in Figure I-01-3 in which the roof drain is diverted to an underground infiltration trench. However, as page I-01-1 of the same Manual states, "Infiltration rates in many areas of the state are typically poor due to clay soils and bedrock;" therefore, this form of disconnecting roof drains is not necessarily feasible within the City of Berry Hill due to the widespread presence of clay soils within Middle Tennessee.


An alternative to this practice is to simply direct roof downspout drains over grassy areas and through grassy swales prior to entering the City maintained storm sewer system or blue-line stream. Another alternative is to capture roof drainage in barrels or other suitable containers for later use as irrigation water. Storing the drainage water would also require mitigation of mosquito breeding through the use of larvae inhibitors or other form of mosquito control.

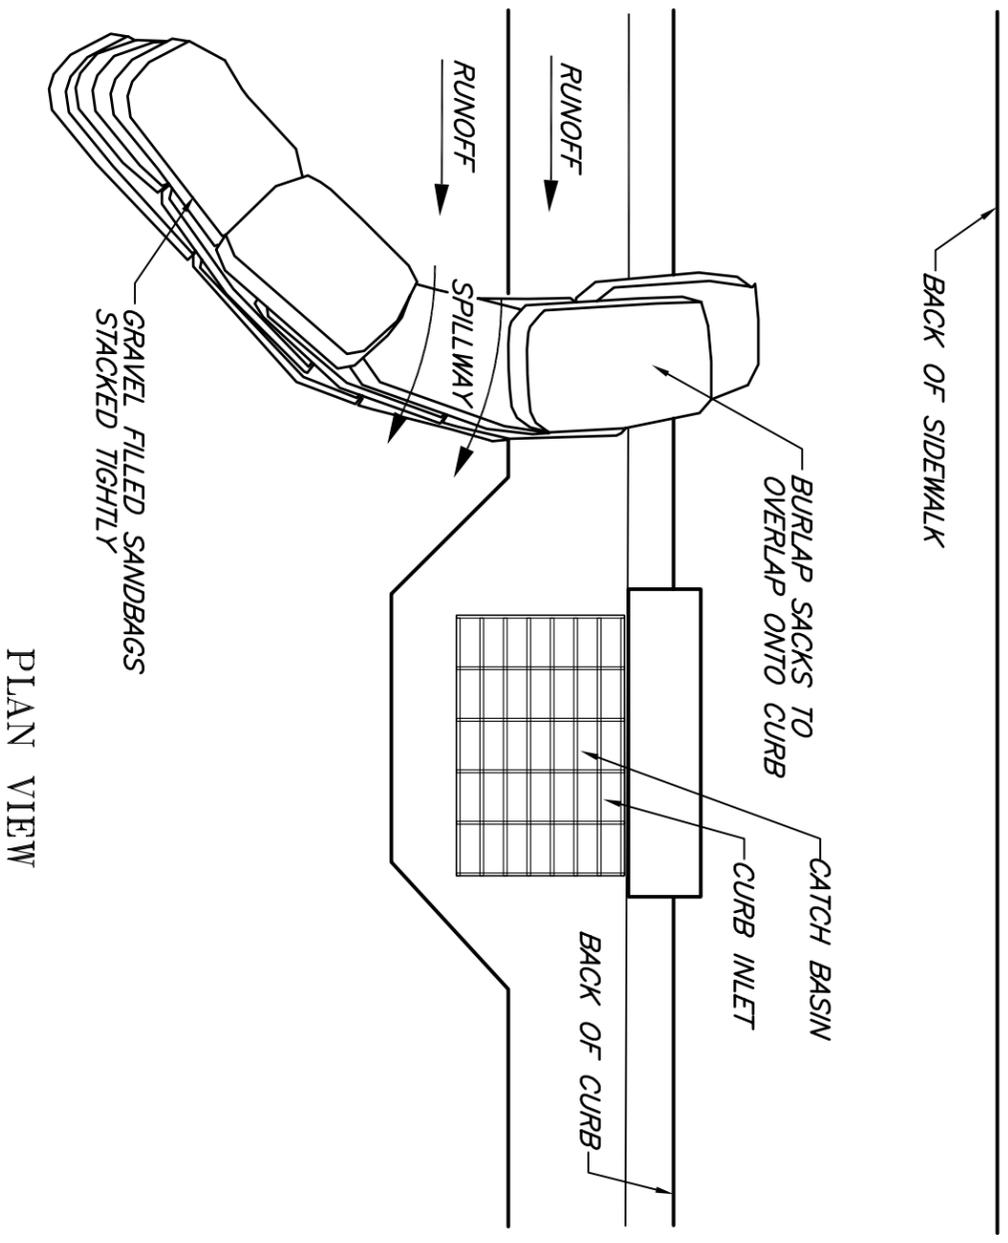

PLAN VIEW

- NOTES:
1. PLACE CURB TYPE SEDIMENT BARRIERS ON GENTLY SLOPING STREET SEGMENTS, WHERE WATER CAN POND AND ALLOW SEDIMENT TO SEPARATE FROM RUNOFF.
 2. SANDBAGS OR FABRIC TUBES OF EITHER BURLAP OR WOVEN 'GEOTEXTILE' FABRIC, ARE FILLED WITH GRAVEL, LAYERED AND PACKED TIGHTLY. NONWOVEN FABRIC CAN ALSO BE USED IF COMPARABLE FILTERING AND FLOW THROUGH CHARACTERISTICS ARE PROVIDED.
 3. LEAVE A ONE SANDBAG GAP IN THE TOP ROW TO PROVIDE A SPILLWAY FOR OVERFLOW.
 4. INSPECT BARRIERS AND REMOVE SEDIMENT AFTER EACH STORM EVENT. SEDIMENT AND GRAVEL MUST BE REMOVED FROM THE TRAVELED WAY IMMEDIATELY.
 5. DO NOT STACK BAGS OVER 12 INCHES HIGH.

SBMP-1
CURB AND GUTTER SEDIMENT BARRIER

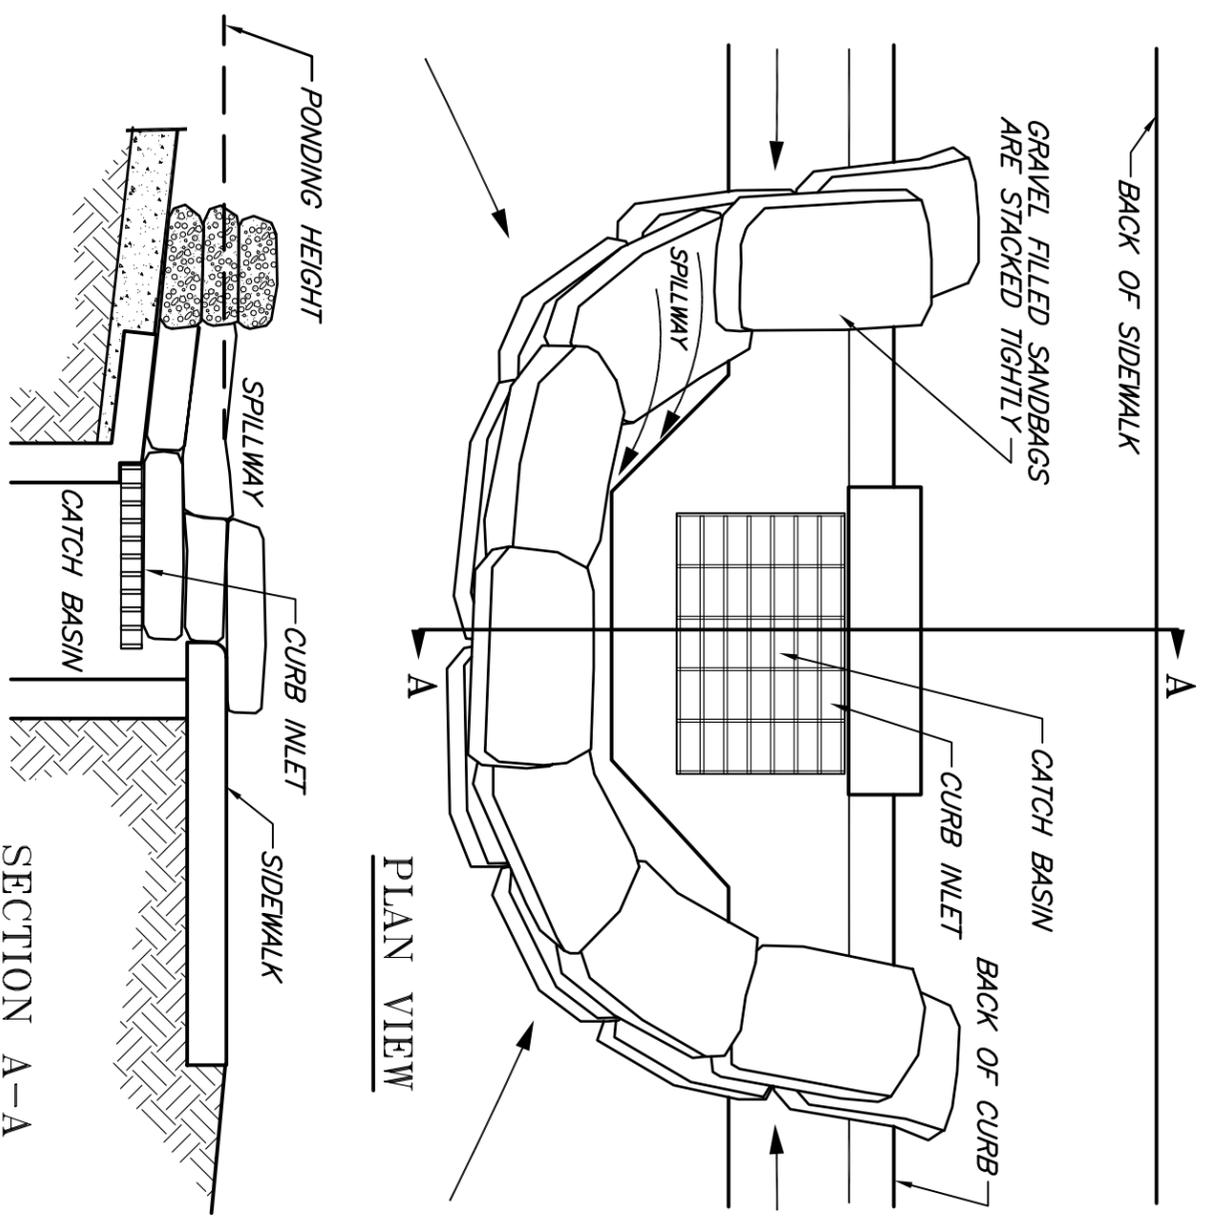

PLAN VIEW

SECTION A-A

- NOTES:
1. PLACE CURB TYPE SEDIMENT BARRIERS ON GENTLY SLOPING STREET SEGMENTS WHERE WATER CAN POND AND ALLOW SEDIMENT TO SEPARATE FROM RUNOFF.
 2. SANDBAGS, OR FABRIC TUBES OF EITHER BURLAP OR WOVEN GEOTEXTILE FABRIC, ARE FILLED WITH GRAVEL, LAYERED AND PACKED TIGHTLY. NONWOVEN FABRIC CAN ALSO BE USED IF COMPARABLE FILTERING AND FLOW-THROUGH CHARACTERISTICS ARE PROVIDED.
 3. LEAVE ONE SANDBAG GAP IN THE TOP ROW TO PROVIDE A SPILLWAY FOR OVERFLOW.
 4. INSPECT BARRIERS AND REMOVE SEDIMENT AFTER EACH STORM EVENT. SEDIMENT AND GRAVEL MUST BE REMOVED FROM THE TRAVELED WAY IMMEDIATELY.
 5. DO NOT STACK BAGS OVER 12 INCHES HIGH.





SBMP-2
CURB INLET SEDIMENT BARRIER (SANDBAGS)

DEC PROJECT NUMBER 040-559	DATE: 7-19-04
SBMP-1&2	DWN. BY: KLU
	CHKD. BY: SEC
	SCALE: N.T.S.

CITY OF BERRY HILL, TN.
SUPPLEMENTAL BMP MANUAL

Civil & Environmental Consultants, Inc.
405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797 (800) 763-2326
Pittsburgh, PA Cincinnati, OH Columbus, OH
Indianapolis, IN Chicago, IL Export, PA St. Louis, MO

TEMPORARY SILT FENCE

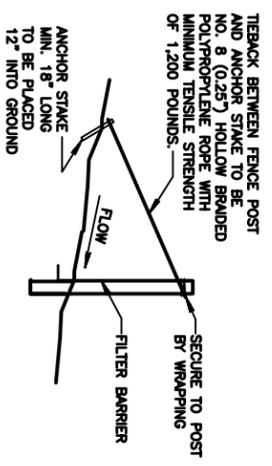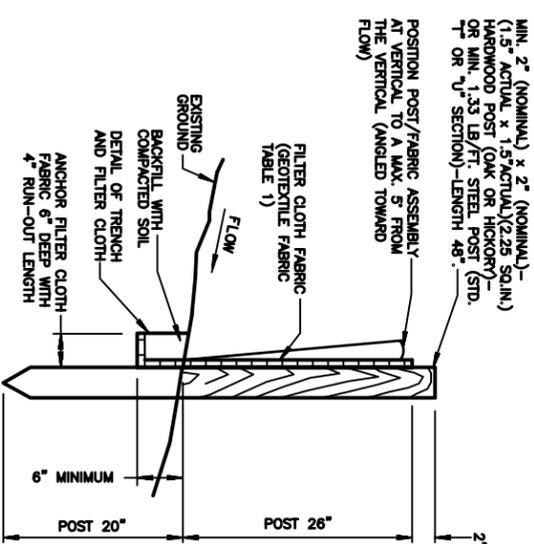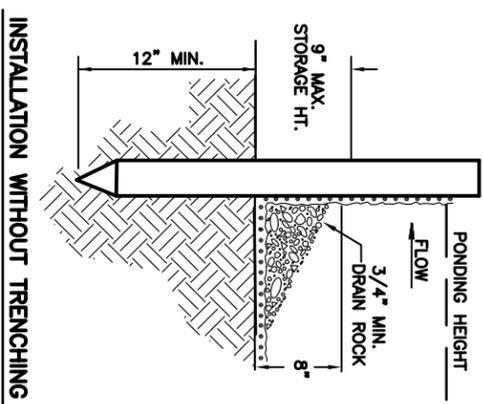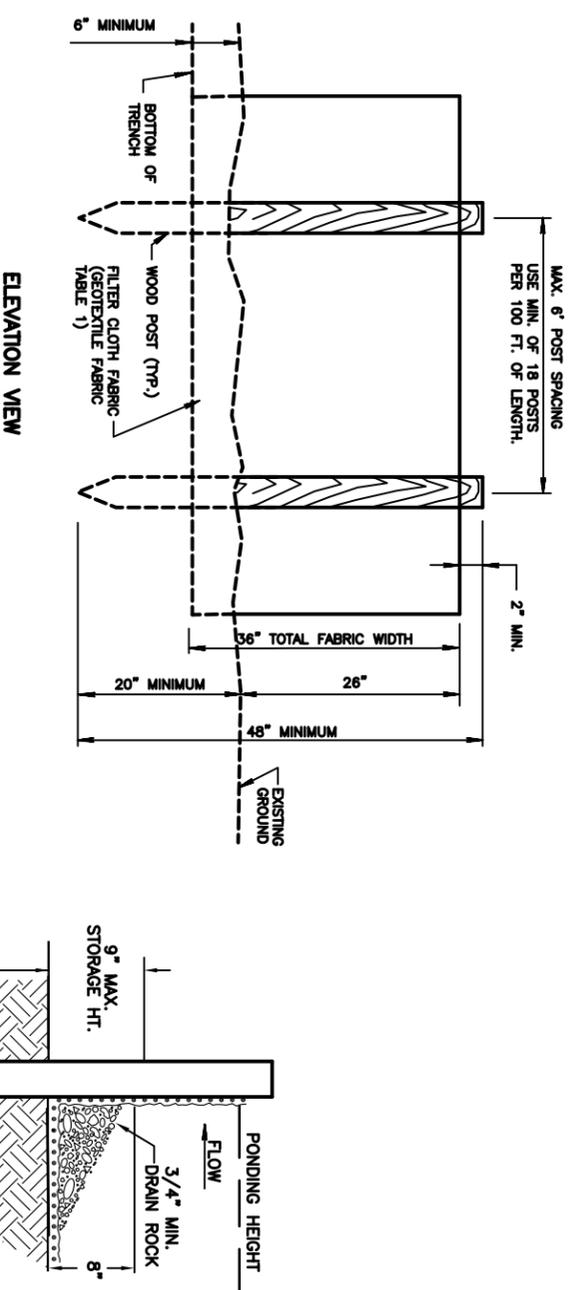

TIEBACK BETWEEN FENCE POST AND ANCHOR STAKE TO BE USED FOR POLYPROPYLENE ROPE WITH MINIMUM TENSILE STRENGTH OF 1,200 POUNDS.

SILT FENCE TIEBACK FOR STEEL POSTS OR WOOD POSTS

(WHEN REQUIRED BY THE ENGINEER OR NOTED IN THE PLANS, COST TO BE INCLUDED IN THE ITEMS FOR TEMPORARY SILT FENCE)

SECTIONAL VIEW

EROSION CONTROL PLAN LEGEND: * SF * SF * SF * (TEMPORARY SILT FENCE)

SBMP-3 SILT FENCE

TABLE 1 TEMPORARY SILT FENCE FABRIC SPECIFICATIONS	
FABRIC PROPERTY AND TEST METHODS	REQUIRED PHYSICAL PROPERTIES (MEAN VALUES OF TEST DATA)
FABRIC TYPE	WOVEN SLIT FILM
APPARENT OPENING SIZE (ASTM D4751)	#50 TO #70 STANDARD SIEVE
PERCENT OPEN AREA (POA)	1% TO 10%
WATER FLUX (ASTM D4491)	≥ 15 GPM/FT ²
TENSILE STRENGTH (ASTM D4632)	≥ 125 LB. (WARP DIRECTION) × 125 LB. (FILL DIRECTION)
ULTRAVIOLET STABILITY (AFTER 500 HRS PER ASTM D4355)	≥ 90%
ELONGATION (ASTM D4632)	≥ 20% (MAX)
BURST STRENGTH (ASTM D3786)	≥ 300 PSI
PUNCTURE STRENGTH (ASTM D4633)	≥ 70 LB.
TRAPEZOIDAL TEAR (ASTM D4633)	≥ 65 LB. (WARP DIRECTION) × 65 LB. (FILL DIRECTION)

TEMPORARY SILT FENCE GENERAL NOTES

- (A)** ALL LABOR AND MATERIALS SHOWN ON THE ELEVATION AND SECTIONAL VIEWS USED TO CONSTRUCT TEMPORARY SILT FENCE ARE TO BE INCLUDED IN THE PRICE BID FOR ITEM 209-08.03 TEMPORARY SILT FENCE (WITHOUT BACKING) PER LINEAR FOOT.
- (B)** SILT FENCES ARE USED TO INTERCEPT SMALL AMOUNTS OF SEDIMENT AND REDUCE VELOCITY FROM SHEET FLOW ONLY. DO NOT USE IT ADJACENT TO SENSITIVE WATER RESOURCES (WETLANDS OR STREAMS).
- (C)** THE MAXIMUM DRAINAGE AREA SIZE FOR A CONTINUOUS BARRIER SHALL BE 1/4 ACRE PER 100 LINEAR FEET OF FENCE LENGTH. MAXIMUM SLOPE LENGTH BEHIND FENCE ON UPSLOPE SIDE SHALL BE 100 FEET (AS MEASURED ALONG THE GROUND SURFACE).
- (D)** WHEN TWO SECTIONS OF FILTER FABRIC ADJOIN EACH OTHER THEY SHALL BE JOINED ACCORDING TO THE DETAILS ON SBMP-8.
- (E)** MAINTENANCE SHALL BE PERFORMED AS NEEDED. CAPTURED SOIL MATERIAL SHALL BE REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE AND/OR OTHER EVIDENCE OF FILTER CLOGGING IS OBSERVED.
- (F)** STEEL POSTS SHALL BE 1.33 LB./FT. ROLLED FROM HIGH CARBON STEEL AND SHALL BE GALVANIZED OR HOT-DIPPED AND PAINTED WITH ONE OR MORE COATS OF HIGH-GRADE WEATHER RESISTANT STEEL PAINT. POSTS SHALL BE STUDDED, EMBOSSED, OR PUNCHED TO AID IN THE ATTACHMENT OF WIRE.
- (G)** WHEN STEEL POSTS ARE USED THEY SHALL HAVE A PROJECTION FOR FASTENING WIRE TO THEM. THE WIRE FASTENERS SHOULD BE EVENLY SPACED WITH AT LEAST FIVE PER POST.
- (H)** IF THE FILTER MATERIAL IS STAPLED TO THE WOODEN STAKES, HEAVY DUTY WIRE STAPLES WITH 1/2 INCH LEG AND 1 INCH WIDTH SHALL BE USED AND EVENLY SPACED WITH AT LEAST FOUR PER POST. FILTER MATERIAL SHALL NOT BE STAPLED TO TREES.
- (I)** SILT FENCES SHOULD BE PLACED ALONG OR NEAR THE GROUND CONTOUR. THE BOTTOM OF FENCE AT GROUNDLINE SHOULD BE ON A ZERO PERCENT (0%) GRADE, PLUS OR MINUS FIVE TENTHS OF ONE PERCENT (±0.5%).
- (J)** A PREASSEMBLED SILT FENCE MEETING THE REQUIREMENTS OF THIS DRAWING IS ACCEPTABLE IN LIEU OF A FIELD CONSTRUCTED SILT FENCE.
- (K)** STATIC SLICING IS THE PREFERRED METHOD OF FENCE INSTALLATION. STATIC SLICING INVOLVES THE INSERTION OF A NARROW CUTTING BLADE, PLACED AT THE SPECIFIED ANCHOR DEPTH FOR THE GIVEN FABRIC AS SHOWN ON THE APPLICABLE DETAIL, AND SIMULTANEOUSLY PULLING THE FENCE FABRIC INTO THE TRENCH AS THE TRENCH IS BEING EXCAVATED. ALTERNATE TRENCH-BASED METHODS ARE ALSO ACCEPTABLE. FOR TRENCH-BASED INSTALLATIONS, FENCING SHALL BE INSTALLED PER THE FOLLOWING STEPS AND IN THE FOLLOWING ORDER:
 - EXCAVATE TRENCH A MAXIMUM OF 4 INCHES WIDE AND AT THE SPECIFIED DEPTH AS SHOWN ON THE APPLICABLE DETAIL. THE TRENCH SHALL BE HAND-CLEANED FOLLOWING EXCAVATION TO REMOVE BULKY DEBRIS SUCH AS ROCKS, STICKS, AND SOIL CLODS FROM THE TRENCH.
 - INSTALL FABRIC IN TRENCH.
 - BACKFILL TRENCH (OVER-FILL) WITH SOIL PLACED AROUND FABRIC.
 - COMPACT SOIL BACKFILL WITH MECHANICAL EQUIPMENT. DO NOT DAMAGE THE FABRIC DURING COMPACTION (DAMAGED FABRIC SHALL BE REPLACED).
 - DRIVE AND SET SUPPORT POSTS PER SPACING REQUIREMENTS GIVEN ON THE APPLICABLE FENCE DETAIL. FOR PRE-ASSEMBLED SILT FENCE, DRIVE SUPPORT IN TO GROUND FIRST, FOLLOWED BY FABRIC PLACEMENT IN TRENCH.
 - ATTACH FABRIC TO THE POSTS USING WIRE TIES OR STAPLES. SPACING AND DENSITY OF TIES OR STAPLES SHALL BE INSTALLED AS GIVEN ON THE APPLICABLE DETAIL.

CEC PROJECT NUMBER
040-559

DATE: **7-19-04**
DWN. BY: **KLU**
CHKD. BY: **SEC**
SCALE: **N.T.S.**


SBMP-3

CITY OF BERRY HILL, TN. SUPPLEMENTAL BMP MANUAL




Civil & Environmental Consultants, Inc.

405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797 (800) 763-2326
Pittsburgh, PA Cincinnati, OH Columbus, OH
Indianapolis, IN Chicago, IL Export, PA St. Louis, MO

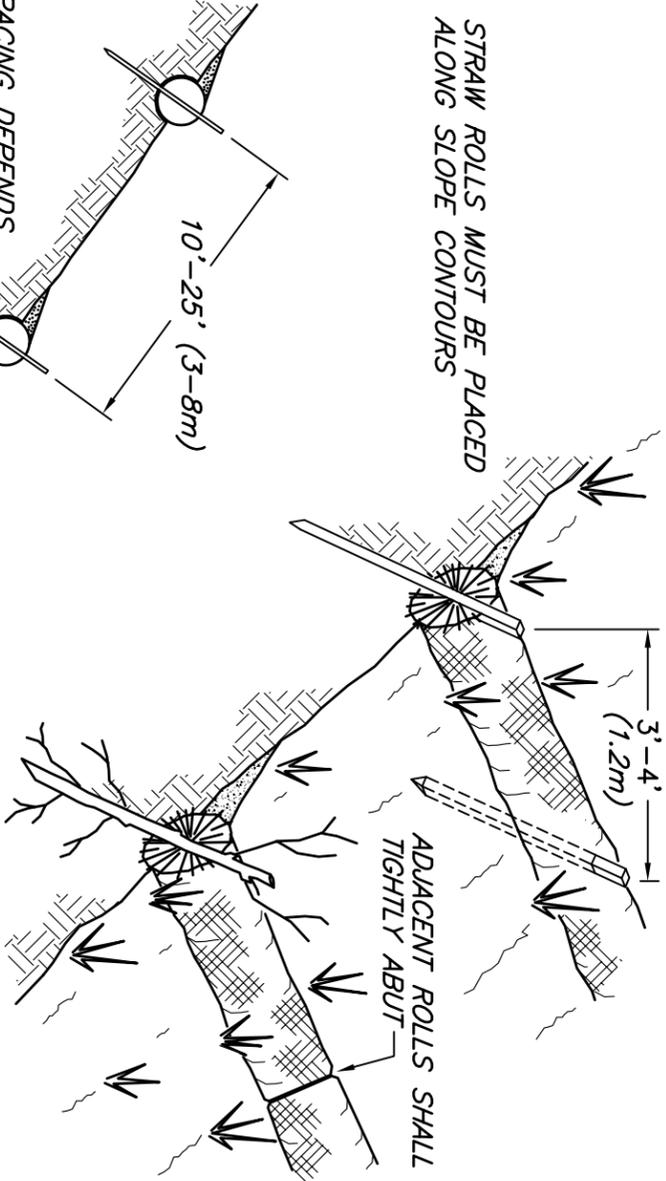

SPACING DEPENDS ON SOIL TYPE AND SLOPE STEEPNESS

SEDIMENT, ORGANIC MATTER, AND NATIVE SEEDS ARE CAPTURED BEHIND THE ROLLS.

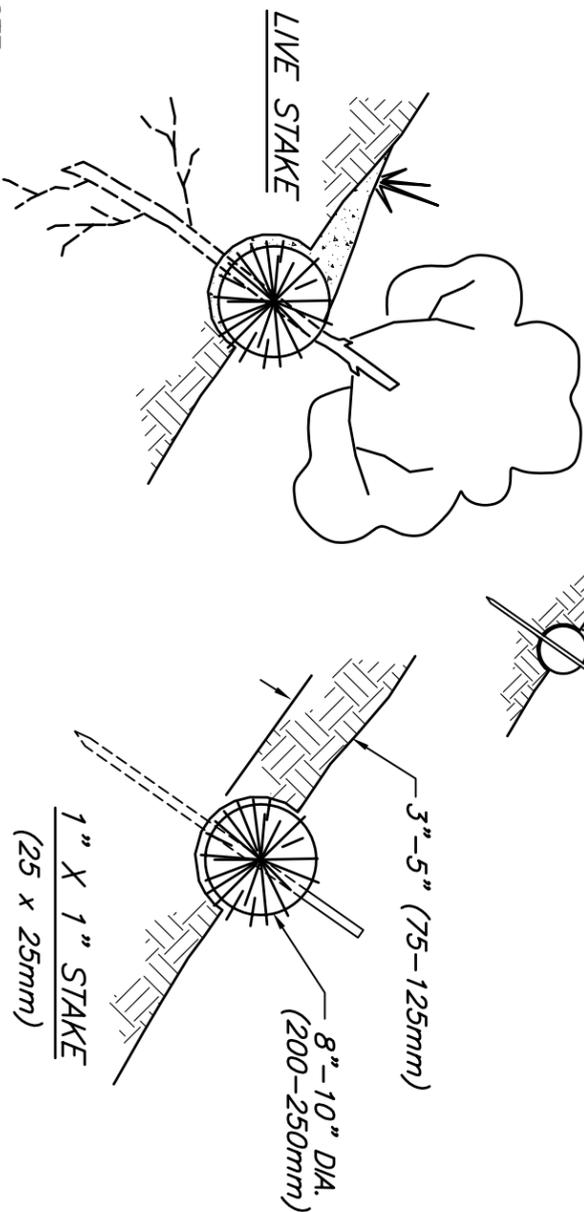

- NOTE:
1. STRAW ROLL INSTALLATION REQUIRES THE PLACEMENT AND SECURE STAKING OF THE ROLL IN A TRENCH, 3"-5" (75-125mm) DEEP, DUG ON CONTOUR. RUNOFF MUST NOT BE ALLOWED TO RUN UNDER OR AROUND ROLL.
 2. STRAW/COIR ROLLS CAN ALSO BE USED.


SBMP-4
STRAW ROLLS

DEC PROJECT NUMBER 040-559	DATE: 7-19-04
DWN. BY: KLU	CHKD. BY: SEC
SCALE: N.T.S.	


CITY OF BERRY HILL, TN.
SUPPLEMENTAL BMP MANUAL

Civil & Environmental Consultants, Inc.
405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797
Pittsburgh, PA (800) 763-2326
Indianapolis, IN Cincinnati, OH
Chicago, IL Export, PA
St. Louis, MO


TEMPORARY SILT FENCE WITH BACKING

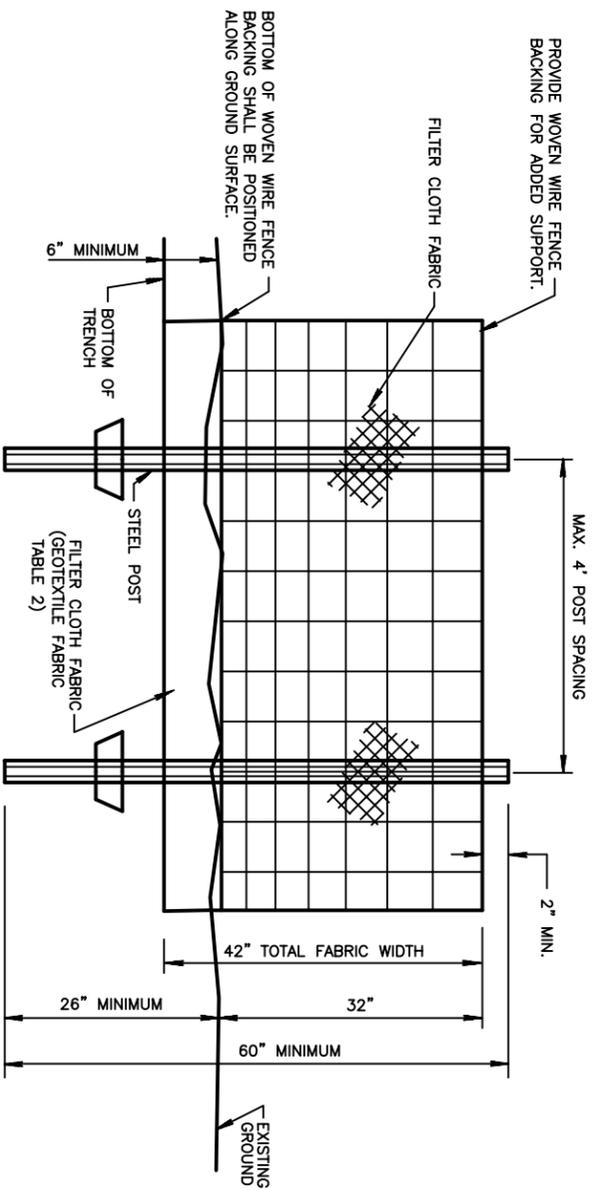

ELEVATION VIEW

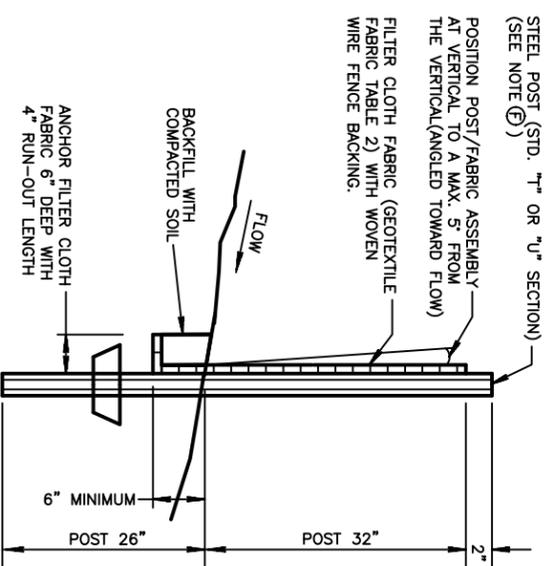

SECTIONAL VIEW

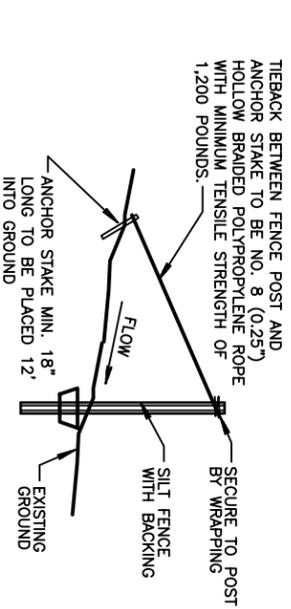

SILT FENCE TIEBACK

WHEN REQUIRED BY THE ENGINEER OR NOTED IN THE PLANS, COST TO BE INCLUDED IN THE ITEMS FOR TEMPORARY SILT FENCE (WITH BACKING)

EROSION CONTROL PLAN LEGEND: * SFB * SFB * SFB * (TEMPORARY SILT FENCE WITH BACKING)

TABLE 2 TEMPORARY SILT FENCE WITH BACKING FABRIC SPECIFICATIONS	
FABRIC PROPERTY AND TEST METHODS	REQUIRED PHYSICAL PROPERTIES (MEAN VALUES OF TEST DATA)
FABRIC TYPE	WOVEN MONOFILAMENT
APPARENT OPENING SIZE (ASTM D4751)	#70 TO #100 STANDARD SIEVE
PERCENT OPEN AREA (POA)	1% TO 10%
WATER FLUX (ASTM D4491)	≥ 20 GPM/FT ²
TENSILE STRENGTH (ASTM D4632)	≥ 375 LB. (WARP DIRECTION) X 240 LB. (FILL DIRECTION)
ULTRAVIOLET STABILITY (AFTER 500 HRS PER ASTM D4355)	≥ 90%
BURST STRENGTH (ASTM D3786)	≥ 460 PSI
PUNCTURE STRENGTH (ASTM D4833)	≥ 140 LB.
TRAPEZOIDAL TEAR (ASTM D4533)	≥ 120 LB. (WARP DIRECTION) X 80 LB. (FILL DIRECTION)

TEMPORARY SILT FENCE WITH BACKING GENERAL NOTES

- (A)** SILT FENCES WITH BACKING ARE USED TO INTERCEPT SMALL AMOUNTS OF SEDIMENT AND REDUCE VELOCITY FROM SHEET FLOW ONLY. USE TEMPORARY SILT FENCES WITH BACKING UPGRADIENT OF AND ADJACENT TO WETLANDS, STREAMS, AND OTHER SENSITIVE WATER RESOURCES.
- (B)** THE MAXIMUM DRAINAGE AREA SIZE FOR A CONTINUOUS SILT FENCE WITH BACKING SHALL BE 1 ACRE PER 150 LINEAR FEET OF FENCE LENGTH. MAXIMUM SLOPE LENGTH BEHIND FENCE ON UPSLOPE SIDE SHALL BE 300 FEET (AS MEASURED ALONG THE GROUND SURFACE).
- (C)** WHEN TWO SECTIONS OF FILTER FABRIC ADJOIN EACH OTHER THEY SHALL BE JOINED ACCORDING TO THE DETAILS ON SBMP-8
- (D)** MAINTENANCE SHALL BE PERFORMED AS NEEDED; CAPTURED SOIL MATERIAL SHALL BE REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE AND/OR WHEN EVIDENCE OF FILTER CLOGGING IS OBSERVED.
- (E)** STEEL POSTS SHALL BE 1.33 LB./FT. ROLLED FROM HIGH CARBON STEEL AND SHALL BE GALVANIZED OR HOT-DIPPED AND PAINTED WITH ONE OR MORE COATS OF HIGH-GRADE WEATHER RESISTANT STEEL PAINT. POSTS SHALL BE STUDDED, EMBOSSED, OR PUNCHED TO AID IN THE ATTACHMENT OF WIRE.
- (F)** STEEL POSTS SHALL HAVE A PROJECTION FOR FASTENING WIRE TO THEM. WOVEN WIRE FENCE BACKING TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES. FABRIC SHALL BE FASTENED SECURELY TO WOVEN WIRE FENCE BACKING WITH THE TIES SPACED EVERY 24 INCHES ALONG TOP AND MIDSECTION. THE WIRE FASTENERS SHOULD BE EVENLY SPACED WITH AT LEAST SIX PER POST.
- (G)** WOVEN WIRE FENCE BACKING SHALL MEET THE REQUIREMENTS FOR ASTM A-116 FOR NO. 11 FARM, DESIGN NO. 832-6-11, CLASS 3 COATING.
- (H)** SILT FENCES SHOULD BE PLACED ALONG OR NEAR THE GROUND CONTOUR. THE BOTTOM OF FENCE AT GROUNDLINE SHOULD BE ON A ZERO PERCENT (0%) GRADE, PLUS OR MINUS FIVE TENTHS OF ONE PERCENT (±0.5%).
- (I)** STATIC SLICING IS THE PREFERRED METHOD OF FENCE INSTALLATION. STATIC SLICING INVOLVES THE INSERTION OF A NARROW CUTTING BLADE, PLACED AT THE SPECIFIED ANCHOR DEPTH FOR THE GIVEN FABRIC AS SHOWN ON THE APPLICABLE DETAIL, AND SIMULTANEOUSLY THE PULLING THE FENCE FABRIC INTO THE TRENCH AS THE TRENCH IS BEING EXCAVATED. ALTERNATE TRENCH-BASED METHODS ARE ALSO ACCEPTABLE. FOR TRENCH-BASED INSTALLATIONS, FENCING SHALL BE INSTALLED PER THE FOLLOWING STEPS AND IN THE FOLLOWING ORDER:
 - EXCAVATE TRENCH A MAXIMUM OF 4 INCHES WIDE AND AT THE SPECIFIED DEPTH AS SHOWN ON THE APPLICABLE DETAIL. THE TRENCH SHALL BE HAND-CLEANED FOLLOWING EXCAVATION TO REMOVE BULKY DEBRIS SUCH AS ROCKS, STICKS, AND SOIL CLOUDS FROM THE TRENCH.
 - INSTALL FABRIC IN TRENCH.
 - BACKFILL TRENCH (OVER-FILL) WITH SOIL PLACED AROUND FABRIC.
 - COMPACT SOIL BACKFILL WITH MECHANICAL EQUIPMENT. DO NOT DAMAGE THE FABRIC DURING COMPACTION (DAMAGED FABRIC SHALL BE REPLACED).
 - DRIVE AND SET SUPPORT POSTS PER SPACING REQUIREMENTS GIVEN ON THE APPLICABLE FENCE DETAIL.
 - ATTACH FABRIC TO THE POSTS USING WIRE TIES. SPACING AND DENSITY OF TIES SHALL BE INSTALLED AS GIVEN ON THE APPLICABLE DETAIL.

SBMP-5 TEMPORARY SILT FENCE WITH BACKING

CEC PROJECT NUMBER
040-559

DATE: 7-19-04
DWN. BY: KLU

SBMP-5


CHKD. BY: SEC
SCALE: N.T.S.

CITY OF BERRY HILL, TN. SUPPLEMENTAL BMP MANUAL




Civil & Environmental Consultants, Inc.
405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797 (800) 763-2326
Pittsburgh, PA Cincinnati, OH Columbus, OH
Indianapolis, IN Chicago, IL Export, PA St. Louis, MO

TEMPORARY ENHANCED SILT FENCE

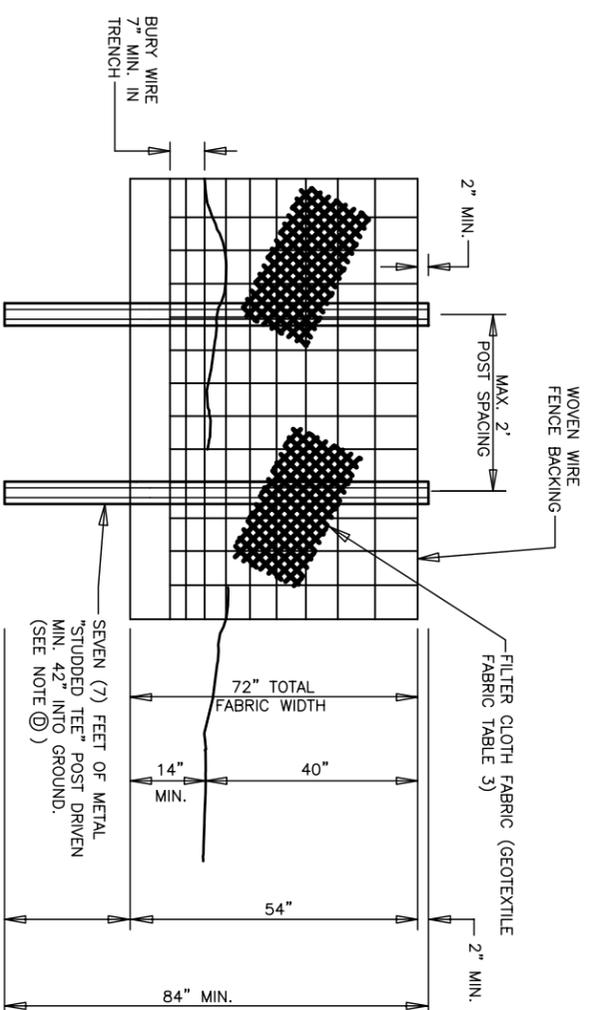

ELEVATION VIEW

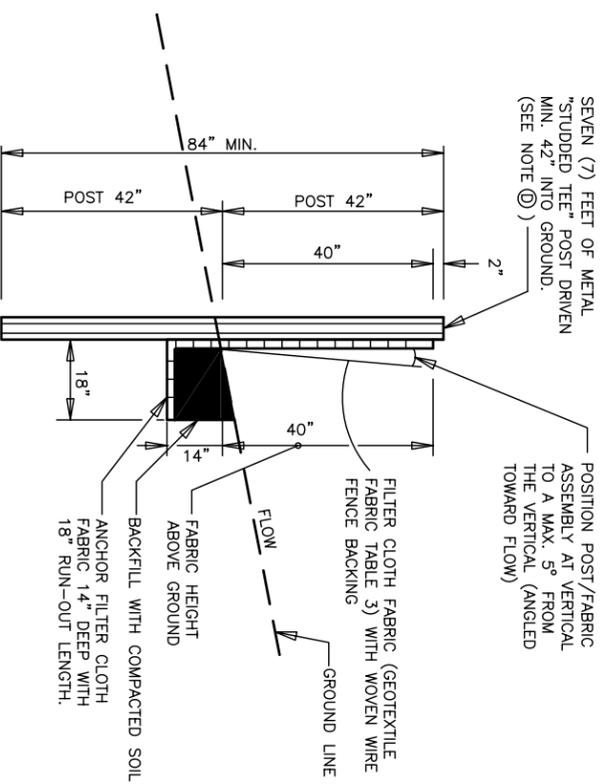

SECTIONAL VIEW

EROSION CONTROL PLAN LEGEND: * ESF * ESF * ESF * (ENHANCED SILT FENCE)

TABLE 3
ENHANCED SILT FABRIC SPECIFICATIONS

FABRIC PROPERTY AND TEST METHODS	REQUIRED PHYSICAL PROPERTIES (MEAN VALUES OF TEST DATA)
FABRIC TYPE	WOVEN MONOFILAMENT
APPARENT OPENING SIZE (ASTM D4751)	#30 TO #80 STANDARD SIEVE
PERCENT OPEN AREA (POA)	≥ 130 GPM/FT ²
WATER FLUX (ASTM D4491)	≥ 390 LB. (WARP DIRECTION) × 260 LB. (FILL DIRECTION)
TENSILE STRENGTH (ASTM D4632)	≥ 90%
ULTRAVIOLET STABILITY (AFTER 500 HRS PER ASTM D4355)	≥ 530 PSI
BURST STRENGTH (ASTM D3786)	≥ 140 LB.
PUNCTURE STRENGTH (ASTM D4833)	≥ 120 LB. (WARP DIRECTION) × 80 LB. (FILL DIRECTION)
TRAPEZOIDAL TEAR (ASTM D4533)	≥ 0.04 INCHES/SEC
PERMEABILITY (ASTM D4491)	≤ 30 MILS
THICKNESS (ASTM D5199)	

ENHANCED SILT FENCE GENERAL NOTES

- (A) ENHANCED SILT FENCE IS TO BE USED WHERE INTERCEPTION OF CONCENTRATED FLOWS (e.g. SWALES, DITCHES, RUTS ALONG SLOPE) ARE ANTICIPATED. LIMITS OF FLOW APPLICATIONS FOR USE OF ENHANCED SILT FENCE ARE GIVEN IN TABLE 4 SBMP-7.
- (B) WHEN TWO SECTIONS OF ENHANCED SILT FABRIC ADJOIN EACH OTHER THEY SHALL BE JOINED ACCORDING TO SBMP-8.
- (C) MAINTENANCE SHALL BE PERFORMED AS NEEDED: CAPTURED SOIL MATERIAL SHALL BE REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE. AND /OR WHEN EVIDENCE OF FILTER BLINDING IS NOTED.
- (D) STEEL POSTS SHALL BE 1.33 LB./FT. ROLLED FROM HIGH CARBON STEEL AND SHALL BE GALVANIZED OR HOT-DIPPED AND PAINTED WITH ONE OR MORE COATS OF HIGH-GRADE WEATHER RESISTANT STEEL PAINT. POSTS SHALL BE STUDDED, EMBOSSED, OR PUNCHED TO AID IN THE ATTACHMENT OF WIRE.
- (E) STEEL POSTS SHALL HAVE A PROJECTION FOR FASTENING WIRE TO THEM. WOVEN WIRE FENCE BACKING TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES. THE WIRE FASTENERS SHOULD BE EVENLY SPACED WITH AT LEAST SIX PER POST.
- (F) WIRE FENCE FABRIC SHALL MEET THE REQUIREMENTS FOR ASTM A-1116 FOR NO. 11 FARM, DESIGN NO. 1047-6-11, CLASS 3 COATING.
- (G) FILTER FABRIC SHALL BE FASTENED SECURELY TO WOVEN WIRE FENCE BACKING WITH TIES SPACED EVERY 24 INCHES ALONG TOP AND MID SECTION.
- (H) FOR TRENCH-BASED INSTALLATIONS, FENCING SHALL BE INSTALLED PER THE FOLLOWING STEPS AND IN THE FOLLOWING ORDER:
 - EXCAVATE TRENCH A MAXIMUM OF 18 INCHES WIDE AND AT THE SPECIFIED DEPTH AS SHOWN ON THE APPLICABLE DETAIL. THE TRENCH SHALL BE HAND-CLEANED FOLLOWING EXCAVATION TO REMOVE BULKY DEBRIS SUCH AS ROCKS, STICKS, AND SOIL CLODS FROM THE TRENCH.
 - INSTALL FABRIC IN TRENCH.
 - BACKFILL TRENCH (OVER-FILL) WITH SOIL PLACED AROUND FABRIC.
 - COMPACT SOIL BACKFILL WITH MECHANICAL EQUIPMENT. DO NOT DAMAGE THE FABRIC DURING COMPACTION (DAMAGED FABRIC SHALL BE REPLACED).
 - DRIVE AND SET SUPPORT POSTS PER SPACING REQUIREMENTS GIVEN ON THE APPLICABLE FENCE DETAIL.
 - ATTACH WOVEN WIRE FENCE BACKING TO POSTS AND FABRIC TO THE WIRE BACKING USING WIRE TIES. SPACING AND DENSITY OF TIES SHALL BE INSTALLED AS GIVEN ON THE APPLICABLE DETAIL.

SBMP-6 TEMPORARY ENHANCED SILT FENCE

CEC PROJECT NUMBER
040-559

DATE: 7-19-04
DWN. BY: KLU

CHKD. BY: SEC


SCALE: N.T.S.

CITY OF BERRY HILL, TN. SUPPLEMENTAL BMP MANUAL




Civil & Environmental Consultants, Inc.

405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797
Pittsburgh, PA (800) 763-2326
Cincinnati, OH
Chicago, IL
Export, PA
St. Louis, MO

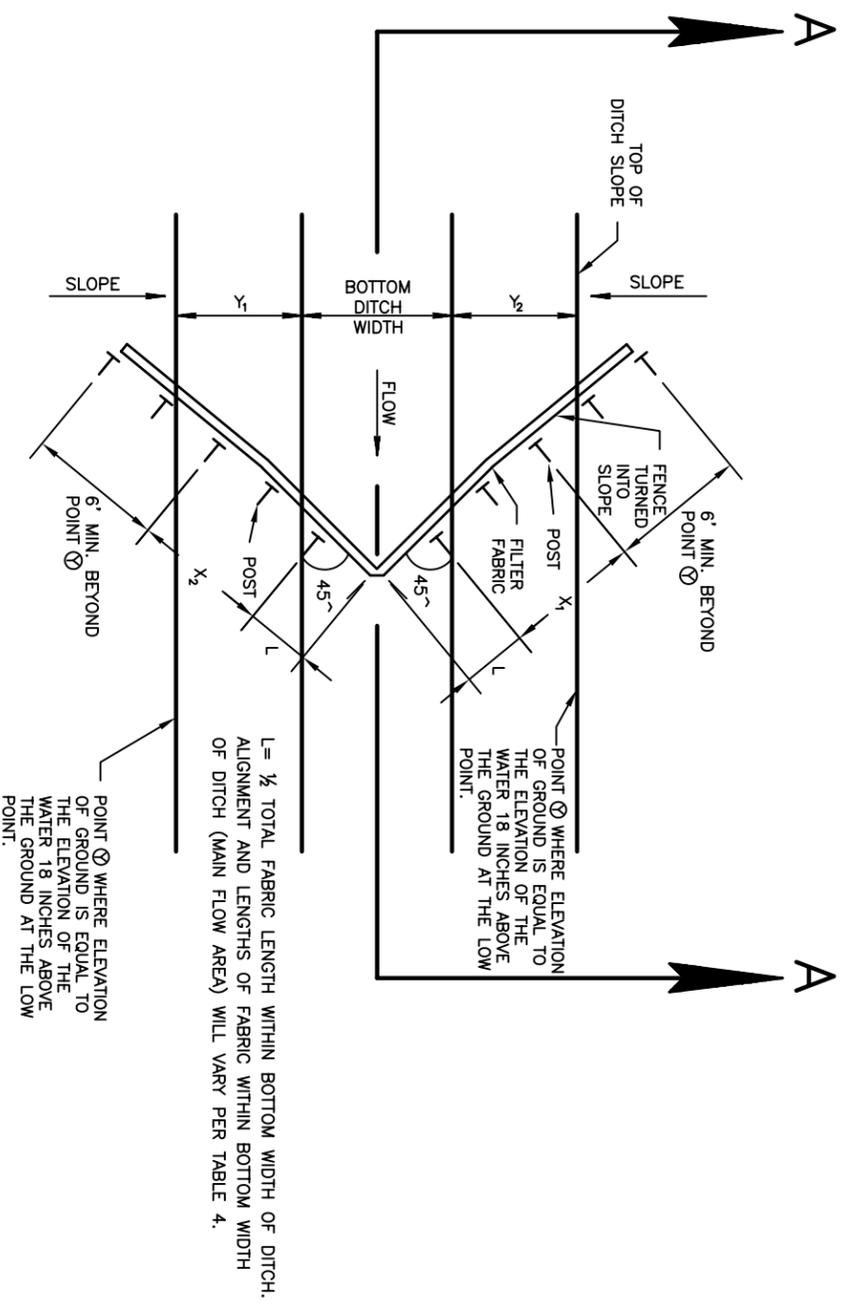


PLAN VIEW

EROSION CONTROL PLAN LEGEND: > ① TEMPORARY TYPE EC 1 FILTER BARRIER DITCH CHECK

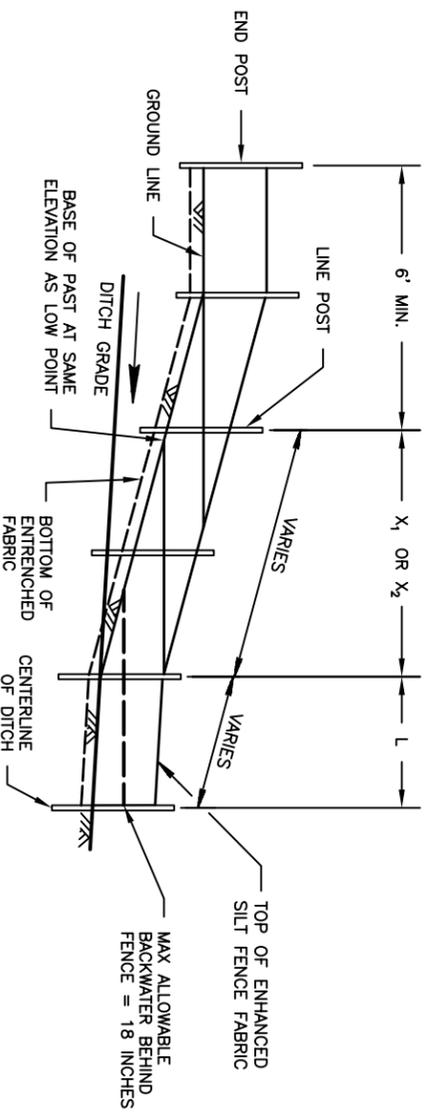

SECTIONAL VIEW A-A

(USE ENHANCED FILTER FABRIC AS DITCH CHECK AND FILTER)

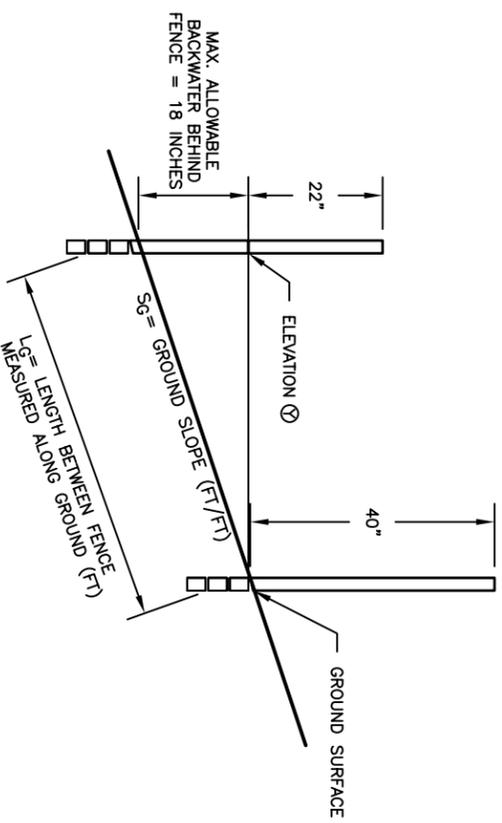

GROUND SLOPE S _g (FT/FT)	⊕ RECOMMENDED SPACING BETWEEN ENHANCED SILT FENCE (FT)
0.01	150
0.02	75
0.03	50
0.04	40
0.05	30
0.06 & STEEPER	25

SPACING FOR ENHANCED SILT FENCE

DITCH WIDTH BOTTOM (FT.)	TOTAL ENHANCED SILT FABRIC LENGTH (2L) WITHIN FLAT-BOTTOM ZONE OF DITCH, (PER LINEAR FOOT)	* MAX. ALLOWABLE DESIGN PEAK FLOW FROM WATERSHED (CFS)
3	4.5	1.8
4	6.0	2.1
5	7.0	2.5
6	8.5	2.9
7	10.0	3.3
8	11.5	3.7
9	13.0	4.0
10	14.5	4.5
12	17.0	5.3
15	21.5	6.5

* BASED ON 60 GPM/FT² ENHANCED SILT FENCE FABRIC. SEE TABLE 3 FOR ENHANCED SILT FENCE FABRIC SPECIFICATION ON DETAIL SBMP-8.

GENERAL NOTES

- (A) A DITCH WITH A TRAPEZOIDAL CROSS-SECTION IS ASSUMED WITH 1:1 SIDESLOPES UNLESS OTHERWISE NOTED.
- (B) FENCE LENGTH DESIGNATED INCLUDES THE LENGTH OF FENCE STAKED WITHIN THE BOTTOM WIDTH OF DITCH (2L).
- (C) IF ANTICIPATED DITCH FLOWS EXCEED THE VALUES SHOWN IN THE TABLE FOR THE GIVEN BOTTOM DITCH WIDTH, THEN PROVIDE A DESIGNED SPILLWAY OR BYPASS FOR OVERFLOW. OTHERWISE, ALTERNATE CHECK OR FILTER STRUCTURES MUST BE USED (E.G., ROCK CHECK/FILTERS).
- (D) ANCHOR AND INSTALL TEMPORARY ENHANCED SILT FENCE PER DETAILS AND SPECIFICATIONS SHOWN ON DETAIL SBMP-8.



**SBMP-7
TEMPORARY EROSION DITCH CHECK USING ENHANCED SILT FENCE**

CEC PROJECT NUMBER 040-559	DATE: 7-19-04
DWN. BY: KLU	CHKD. BY: SEC
SCALE: N.T.S.	

CITY OF BERRY HILL, TN.
SUPPLEMENTAL BMP MANUAL






Civil & Environmental Consultants, Inc.
405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797
Pittsburgh, PA
Cincinnati, OH
Chicago, IL
Columbus, OH
St. Louis, MO

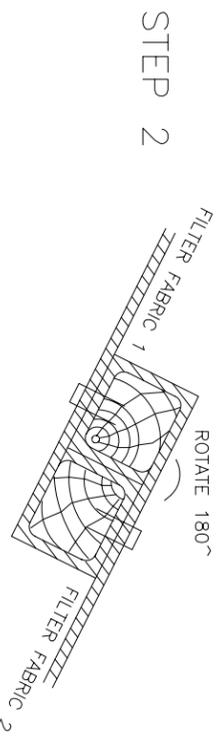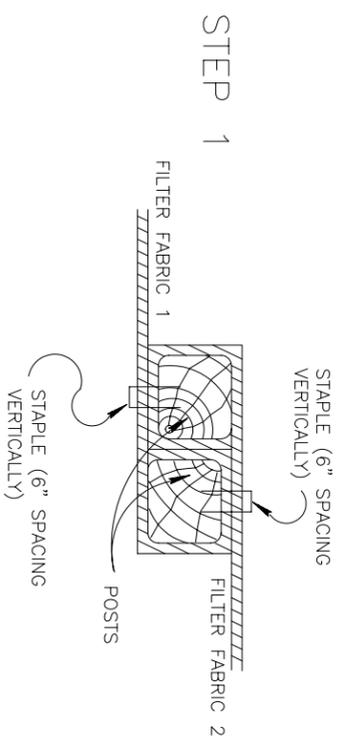

- ① ROTATE BOTH POSTS WITH FABRIC CLOCKWISE AT LEAST 180°.
- ② EMBED BOTH POSTS INTO GROUND PER APPLICABLE FILTER FENCE SPECIFICATIONS.

PLAN VIEW
JOINING EROSION CONTROL
FABRIC SECTIONS (WOOD POSTS)

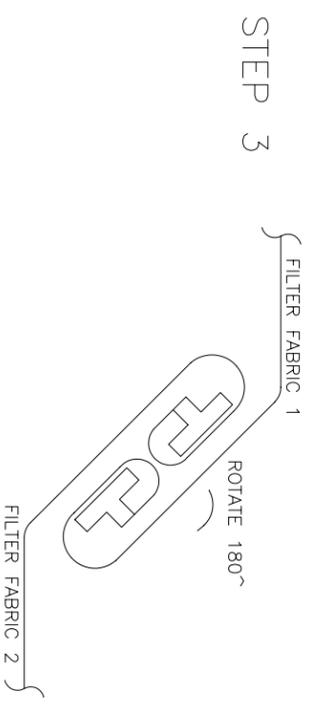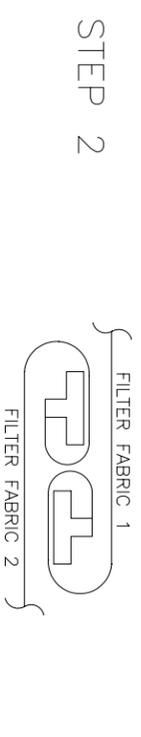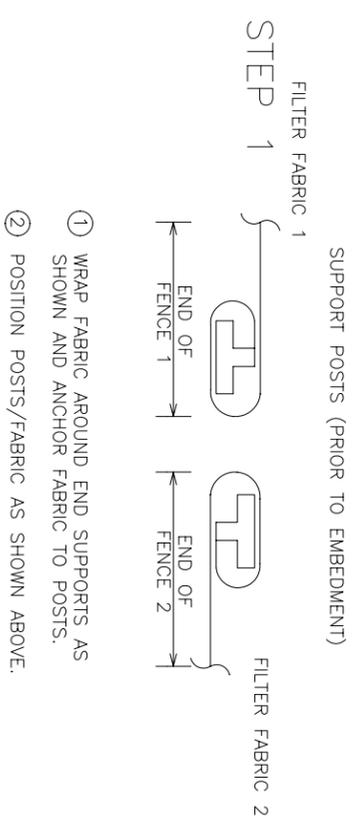

PLAN VIEW
JOINING EROSION CONTROL
FABRIC SECTIONS (STEEL POSTS)

SBMP-8
EROSION CONTROL FABRIC JOINING DETAILS


CEC PROJECT NUMBER
040-559

SBMP-8

DATE: 7-19-04
DWN. BY: KLU

CHKD. BY: SEC
SCALE: N.T.S.

CITY OF BERRY HILL, TN.
SUPPLEMENTAL BMP MANUAL



Civil & Environmental Consultants, Inc.
405 Duke Drive, Suite 270
Franklin, TN 37067
(615) 333-7797
Pittsburgh, PA (800) 763-2326
Cincinnati, OH
Chicago, IL
Export, PA
St. Louis, MO